
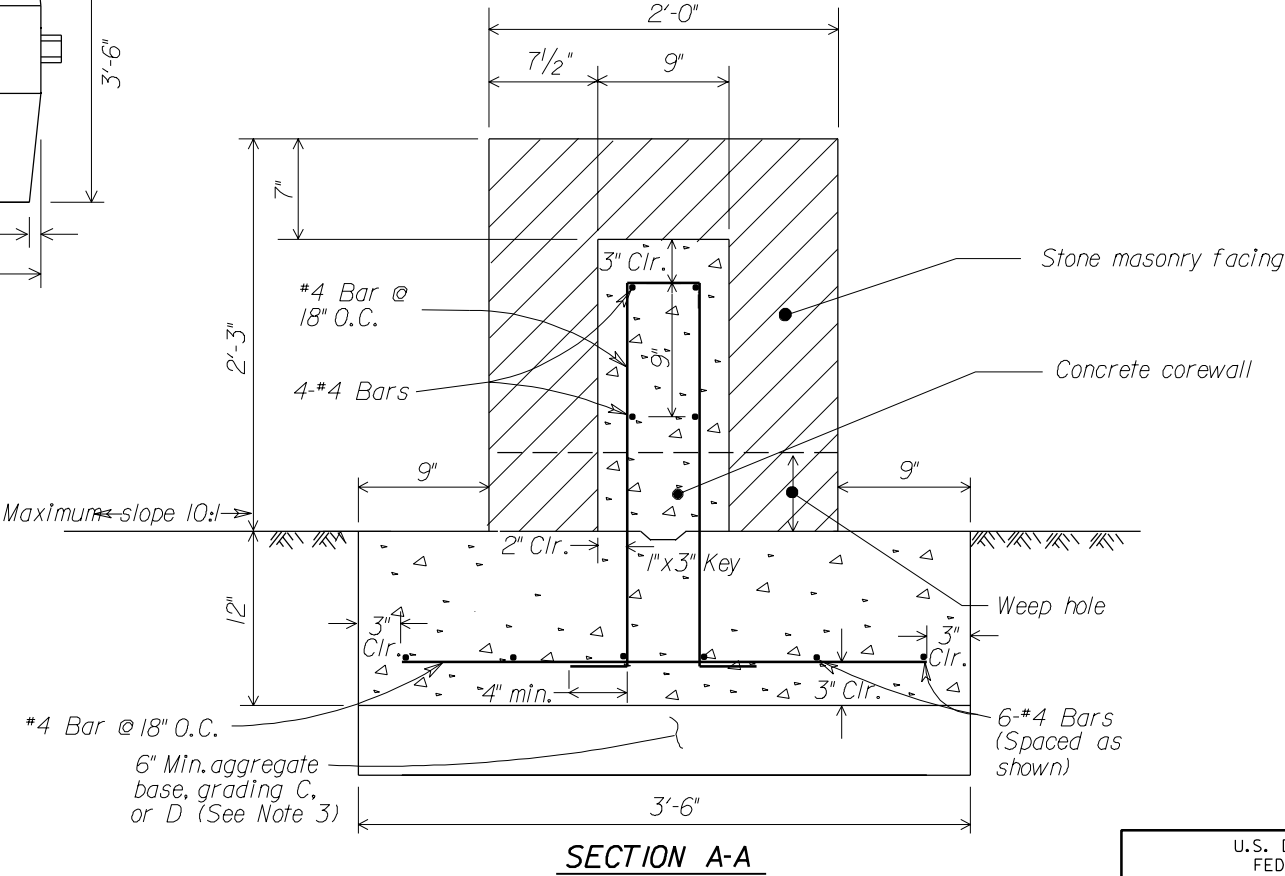
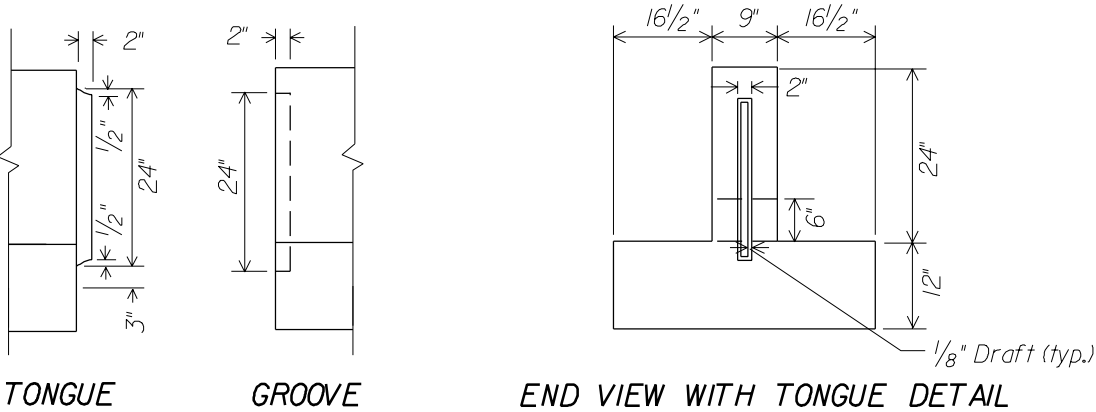


- Notes:
1. Form construction joints in the corewall at 30-foot intervals or, at the option of the Contractor, the corewall may be constructed of precast concrete units.
 2. On curves with radius less than 150 feet, the corewall is to be cast-in-place.
 3. The depth of base may be less than 6" as directed by the CO, when the foundation is on either rock fill or solid rock.
 4. Galvanized metal slots with anchors for the stone work or other approved type of metal are to be set in the concrete. Equivalent attachment systems are allowed with the approval of the CO.

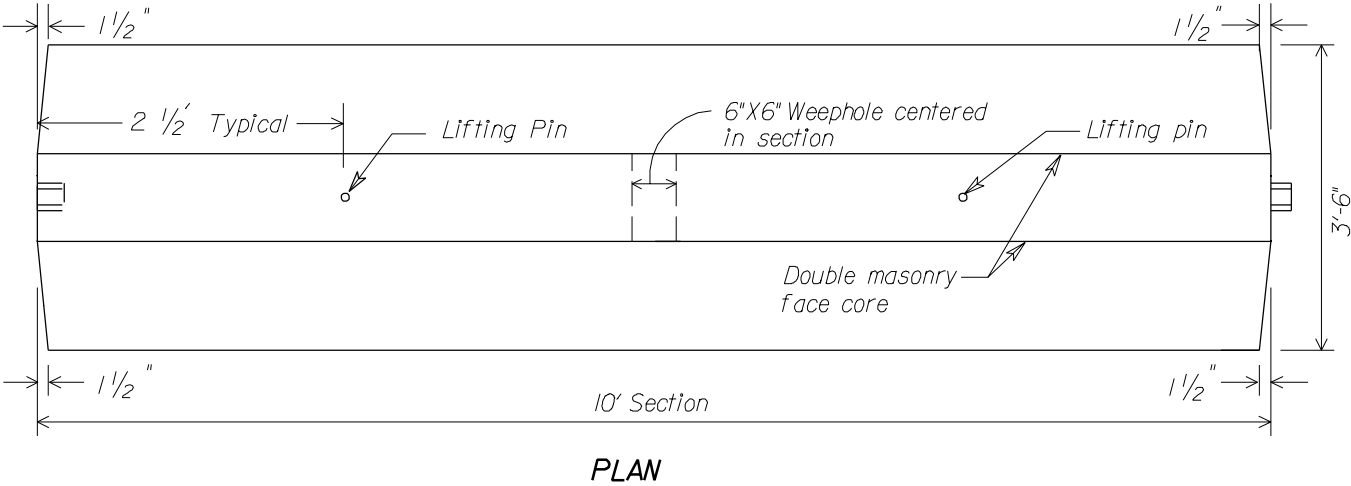

PRECAST CONCRETE COREWALL DETAILS

No Scale

U.S. DEPARTMENT OF TRANSPORTATION FEDERAL HIGHWAY ADMINISTRATION FEDERAL LANDS HIGHWAY	
STANDARD	
STONE MASONRY GUARDWALL	
STANDARD APPROVED FOR USE --/----	STANDARD
REVISED:	620-1